
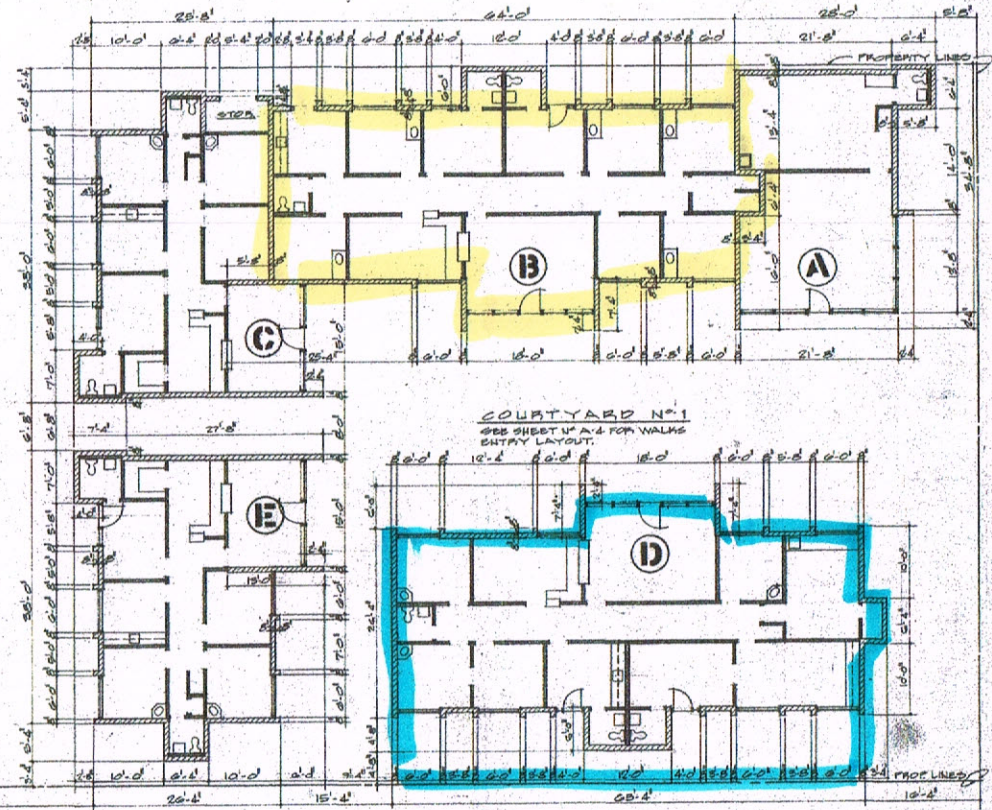


0
3
K
L
J
D

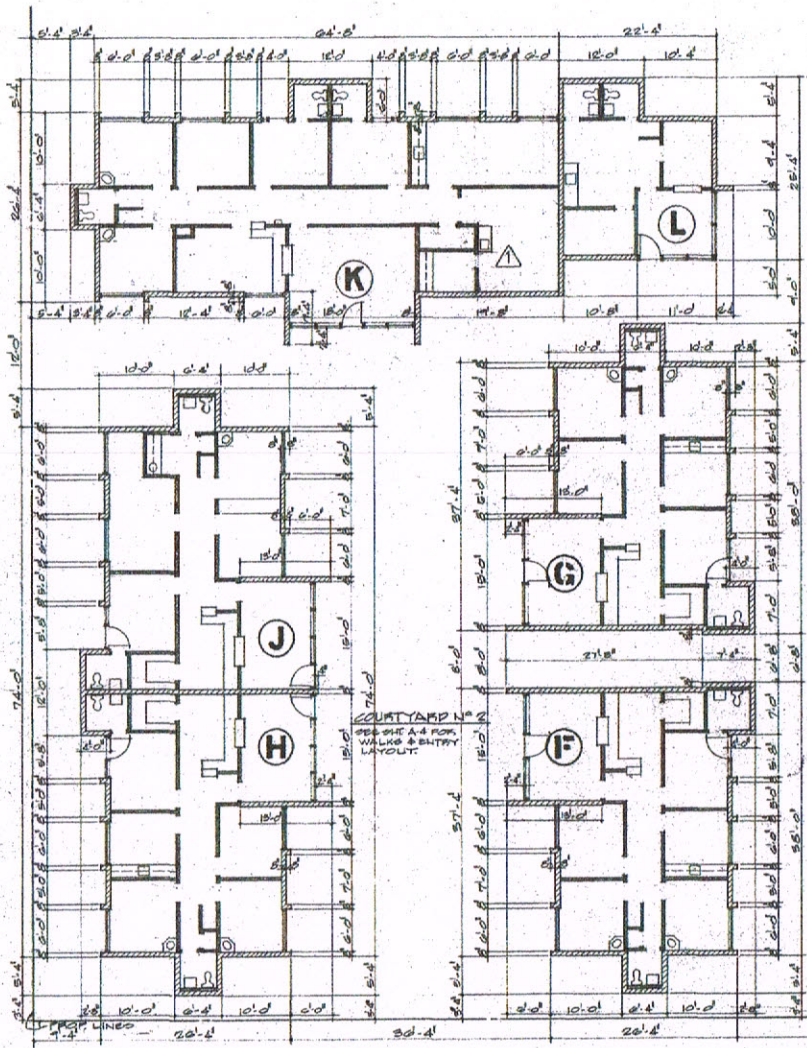

COURTYARD NO. 1
SEE SHEET A-4 FOR WALKS
ENTRY LAYOUT.

FLOOR PLAN N.
1/8" = 1'-0"

- MASONRY NOTES:**
1. MASONRY UNITS SHALL BE GRADE 'A', ASTM C-10
 2. CONCRETE MASONRY UNITS, FTM # 1360 PSL
 3. ALL EXTERIOR WALLS SHALL HAVE #5 VERTICAL BARS & WALL CORNERS, WALL INTERSECTIONS, JAMBS OF ALL WALL OPENINGS, # 5 INTERVALS NOT TO EXCEED 40'-0".
 4. ALL WALLS SHALL HAVE A HORIZ. BEAM W/ 2 #4 BARS @ ROOF LINE.
 5. PROVIDE DIA. 0-WAL REINFORCING @ 16" O.C. IN HORIZ. JOINTS
 6. REINFORCING SHALL LAP A MINIMUM OF 50 DIA. DIAMETERS, & GREIT. = 2,000 PSI.
 7. MORTAR = TYPE 10, 1500 PSI.

DONALD H. CRAMER
ARCHITECT A.I.A.

