
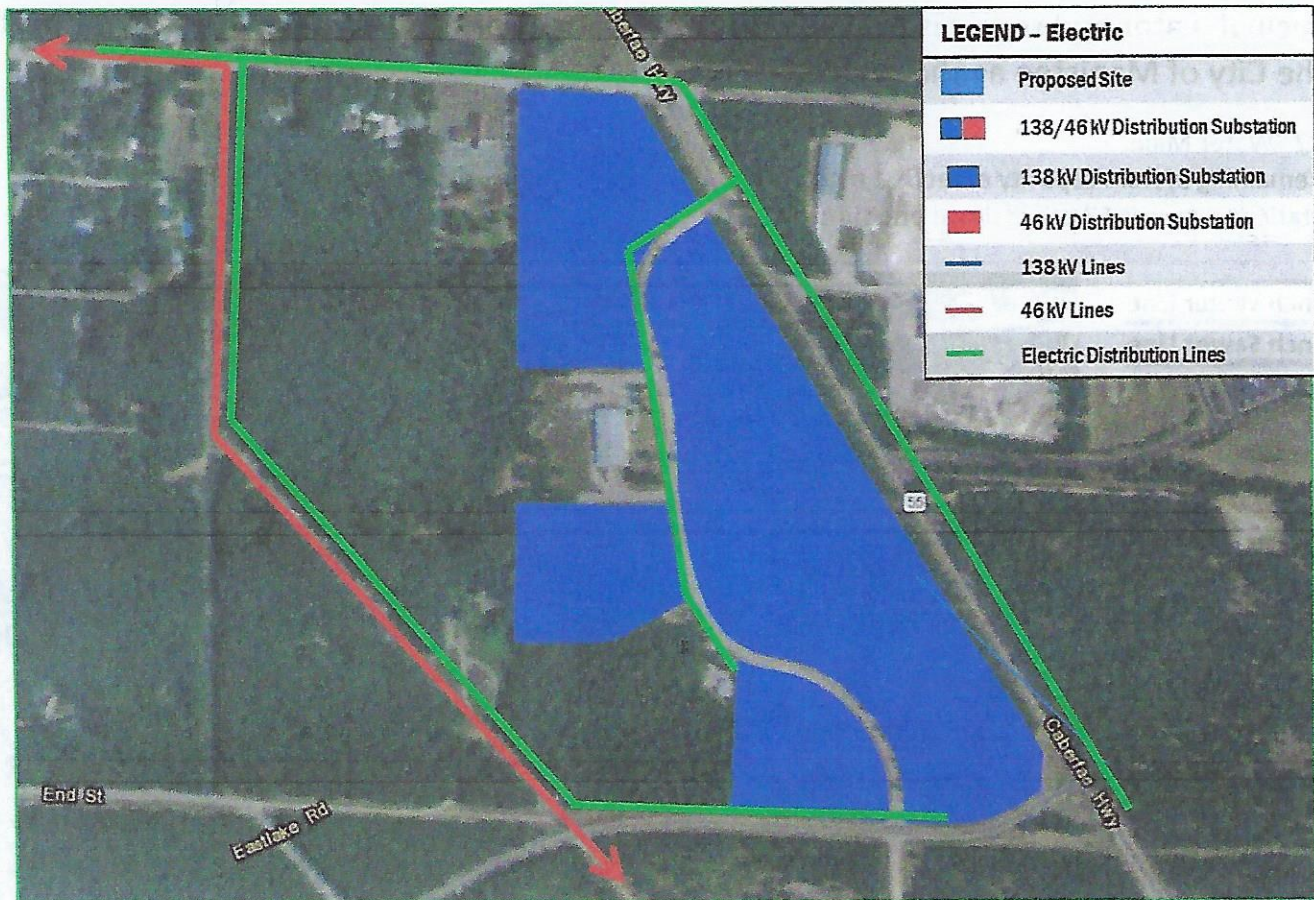


Energy Profile – Manistee Township Manistee Renaissance Park



All existing facility locations are approximate and are not to be used for construction purposes. Always contact MISS DIG 811 before you dig.

Electric Site Benefits

- **Distribution System**
 - Predicted reliability of up to 99.998%*.
 - Distribution facilities existing in the industrial park
- **46 kV System**
 - Predicted reliability of up to 99.994%*.
 - Close proximity to the 46 kV system that is approximately 0.75 miles away from this location.
 - Able to serve a range of possible electric demand with appropriate substation and minimal line construction.
- **138 kV System**
 - Predicted reliability of up to 99.997%*.
 - The 138 kV system is approximately 2.6 miles away from this location.
 - Able to serve a wide range of possible electric demand with appropriate substation and line construction.

*The predicted reliability percentage represents the estimated amount of time the facility is in service.

For additional information

Michele Eaton, Economic Development Manager | 810-760-3497 | michele.eaton@cmsenergy.com